


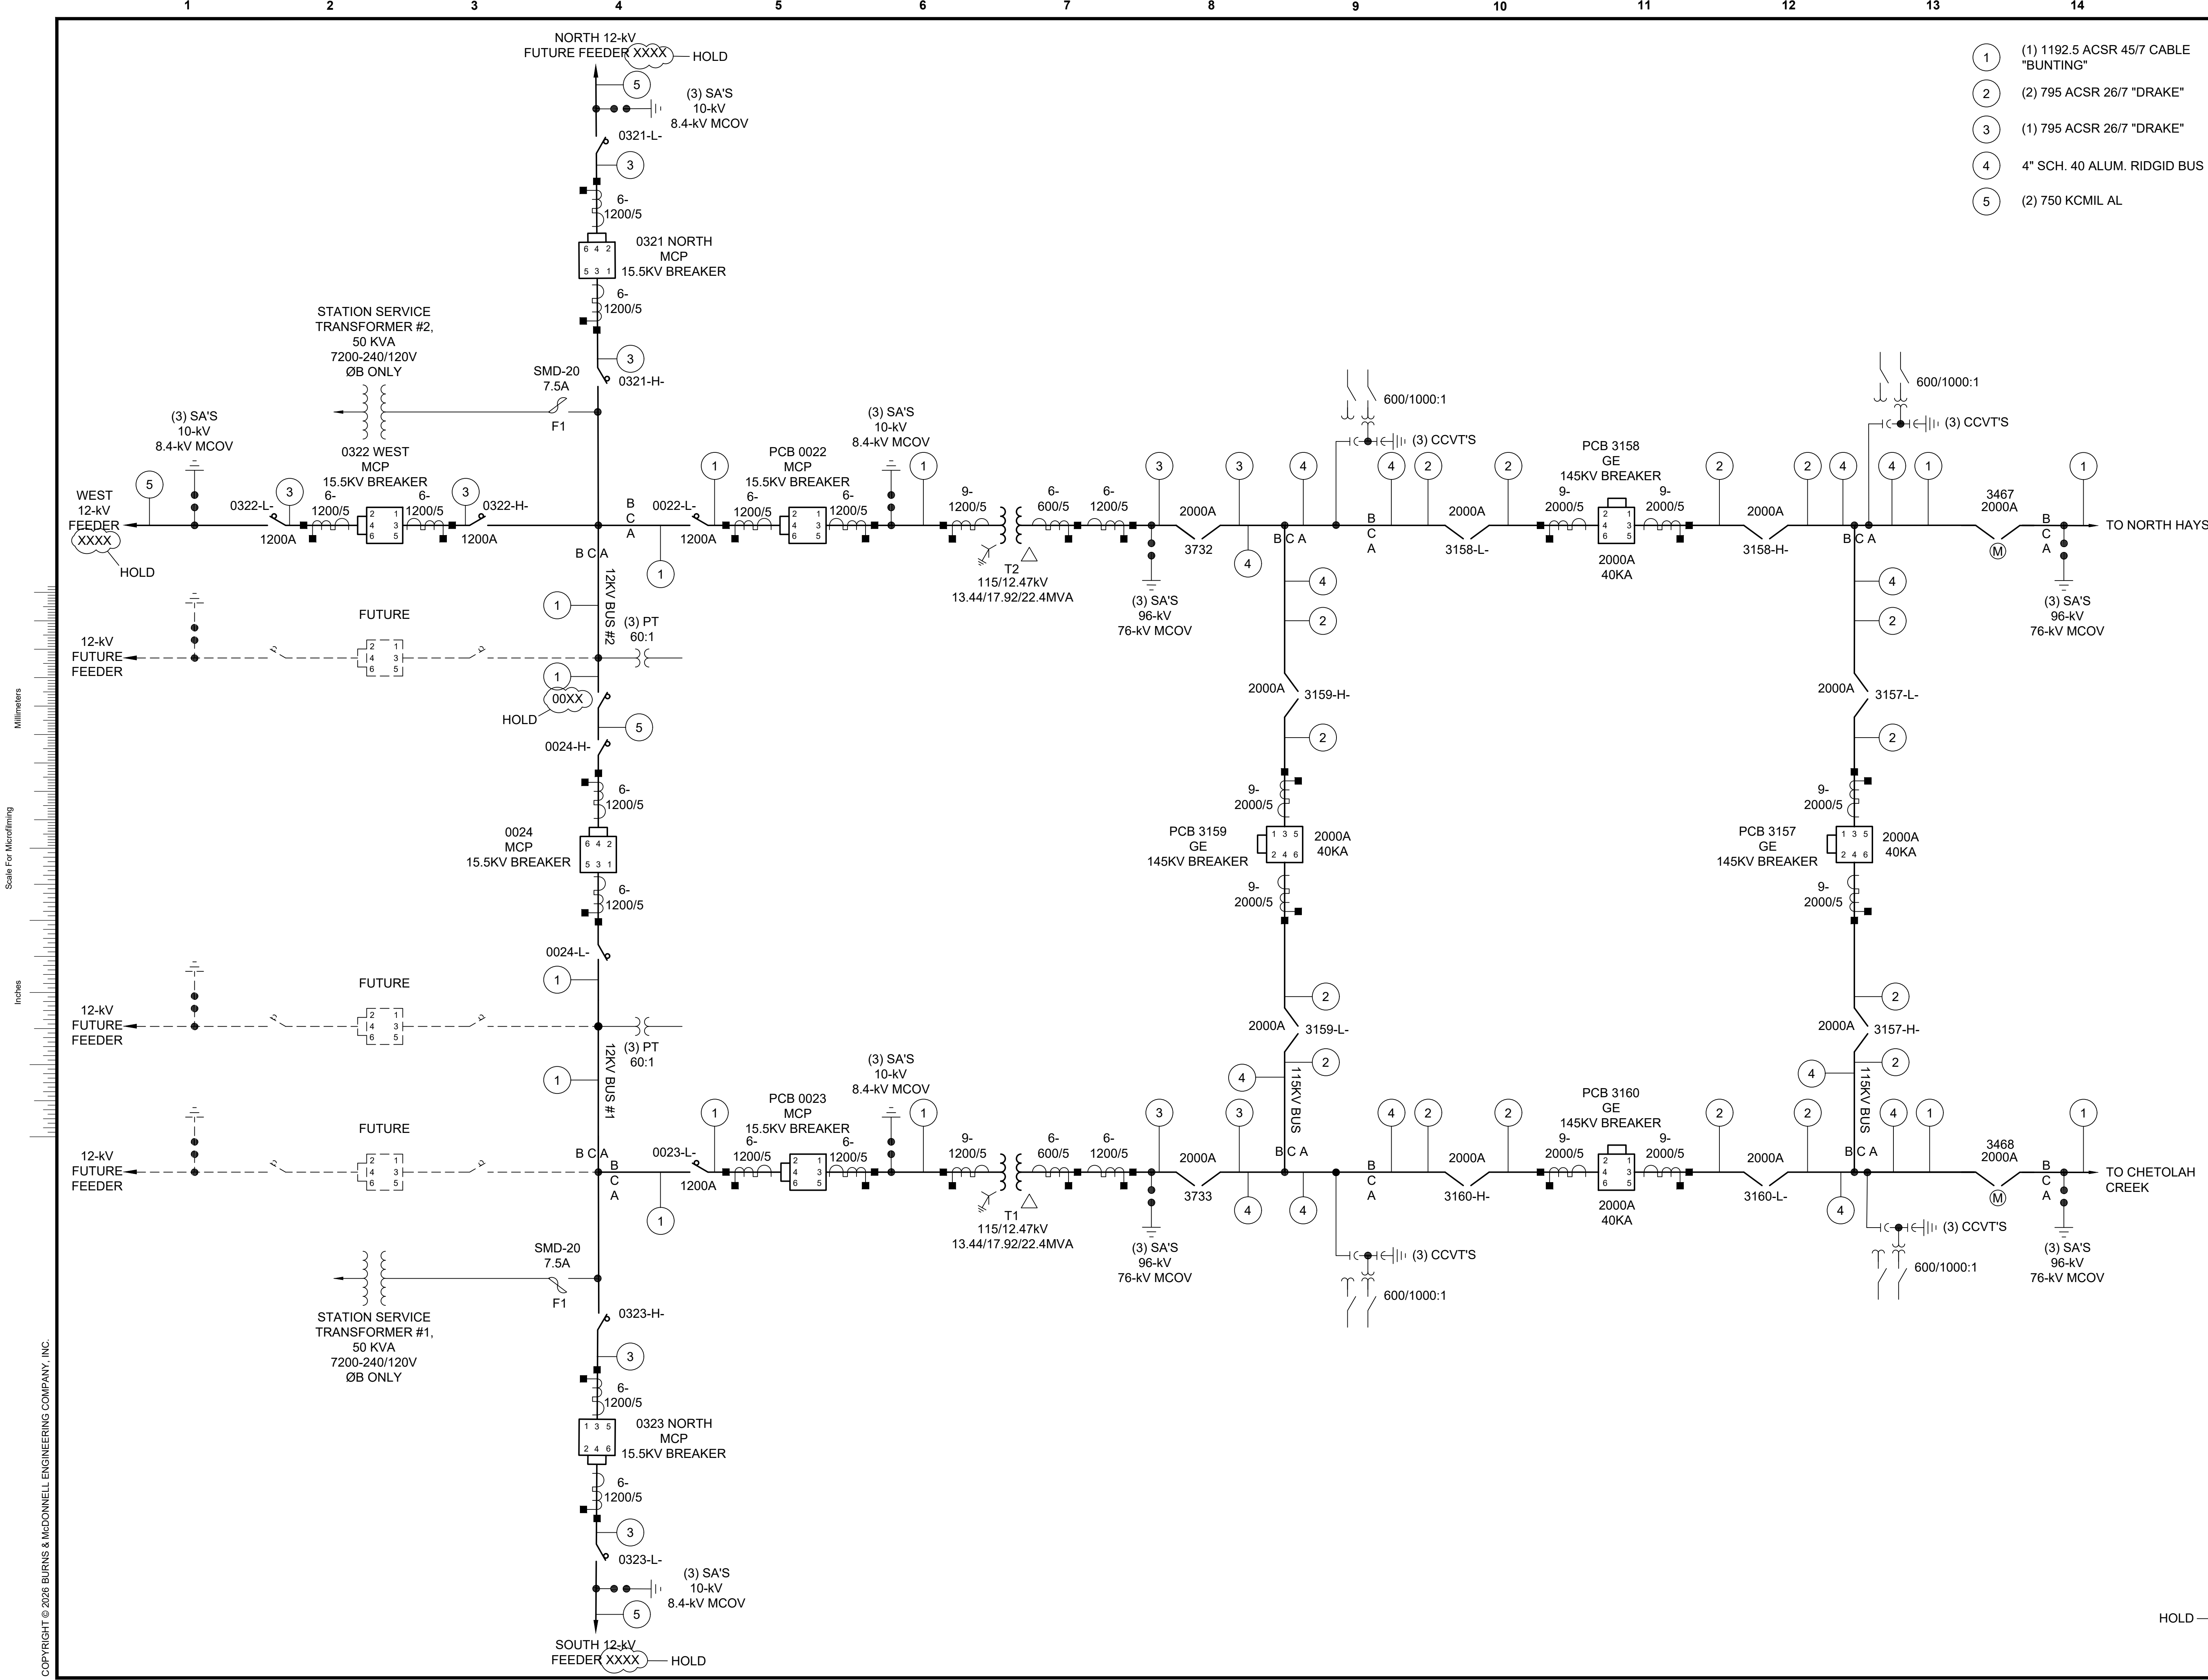

- 1 (1) 1192.5 ACSR 45/7 CABLE "BUNTING"
- 2 (2) 795 ACSR 26/7 "DRAKE"
- 3 (1) 795 ACSR 26/7 "DRAKE"
- 4 4" SCH. 40 ALUM. RIDGID BUS
- 5 (2) 750 KCMIL AL

no.	date	by	ckd	description
0	6/25/26	RJB	HA	ISSUED FOR BID

LEGEND:

- COUPLING CAPACITOR
- VOLTAGE TRANSFORMER
- SURGE ARRESTER
- MANUAL CENTER BREAK DISCONNECT SWITCH
- MOTORIZED CENTER BREAK DISCONNECT SWITCH
- CURRENT TRANSFORMER
- 3Ø POWER CIRCUIT BREAKER
- TRANSFORMER
- VERTICAL BREAK SWITCH
- STATION SERVICE TRANSFORMER
- FUSE
- POWER TRANSFORMER - DELTA PRIMARY WINDING, GROUNDED WYE SECONDARY WINDING

NOTE:
1. * DENOTES DRY CONTACT REQUIRED FOR SCADA INDICATION.

ISSUED FOR BID

BURNS & MCDONNELL

9400 WARD PARKWAY
KANSAS CITY, MO 64114
816-339-9400
LICENSEE NO. E-65

date	01/01/0001	detailed	R. BECHER
designed	R. BECHER	checked	H. ABEER

Midwest Energy, Inc.
1330 Canterbury Rd.
Hays, Kansas 67601
(785) 625-3437

EAST HAYS SUBSTATION
ELEMENTARY
ONE LINE
DIAGRAM

project 193866 contract WXX-XXXX-X

drawing XXXE1000-0

sheet 1 of 1 sheets

file XXXE1000.dwg