




ISSUED FOR
CONSTRUCTION

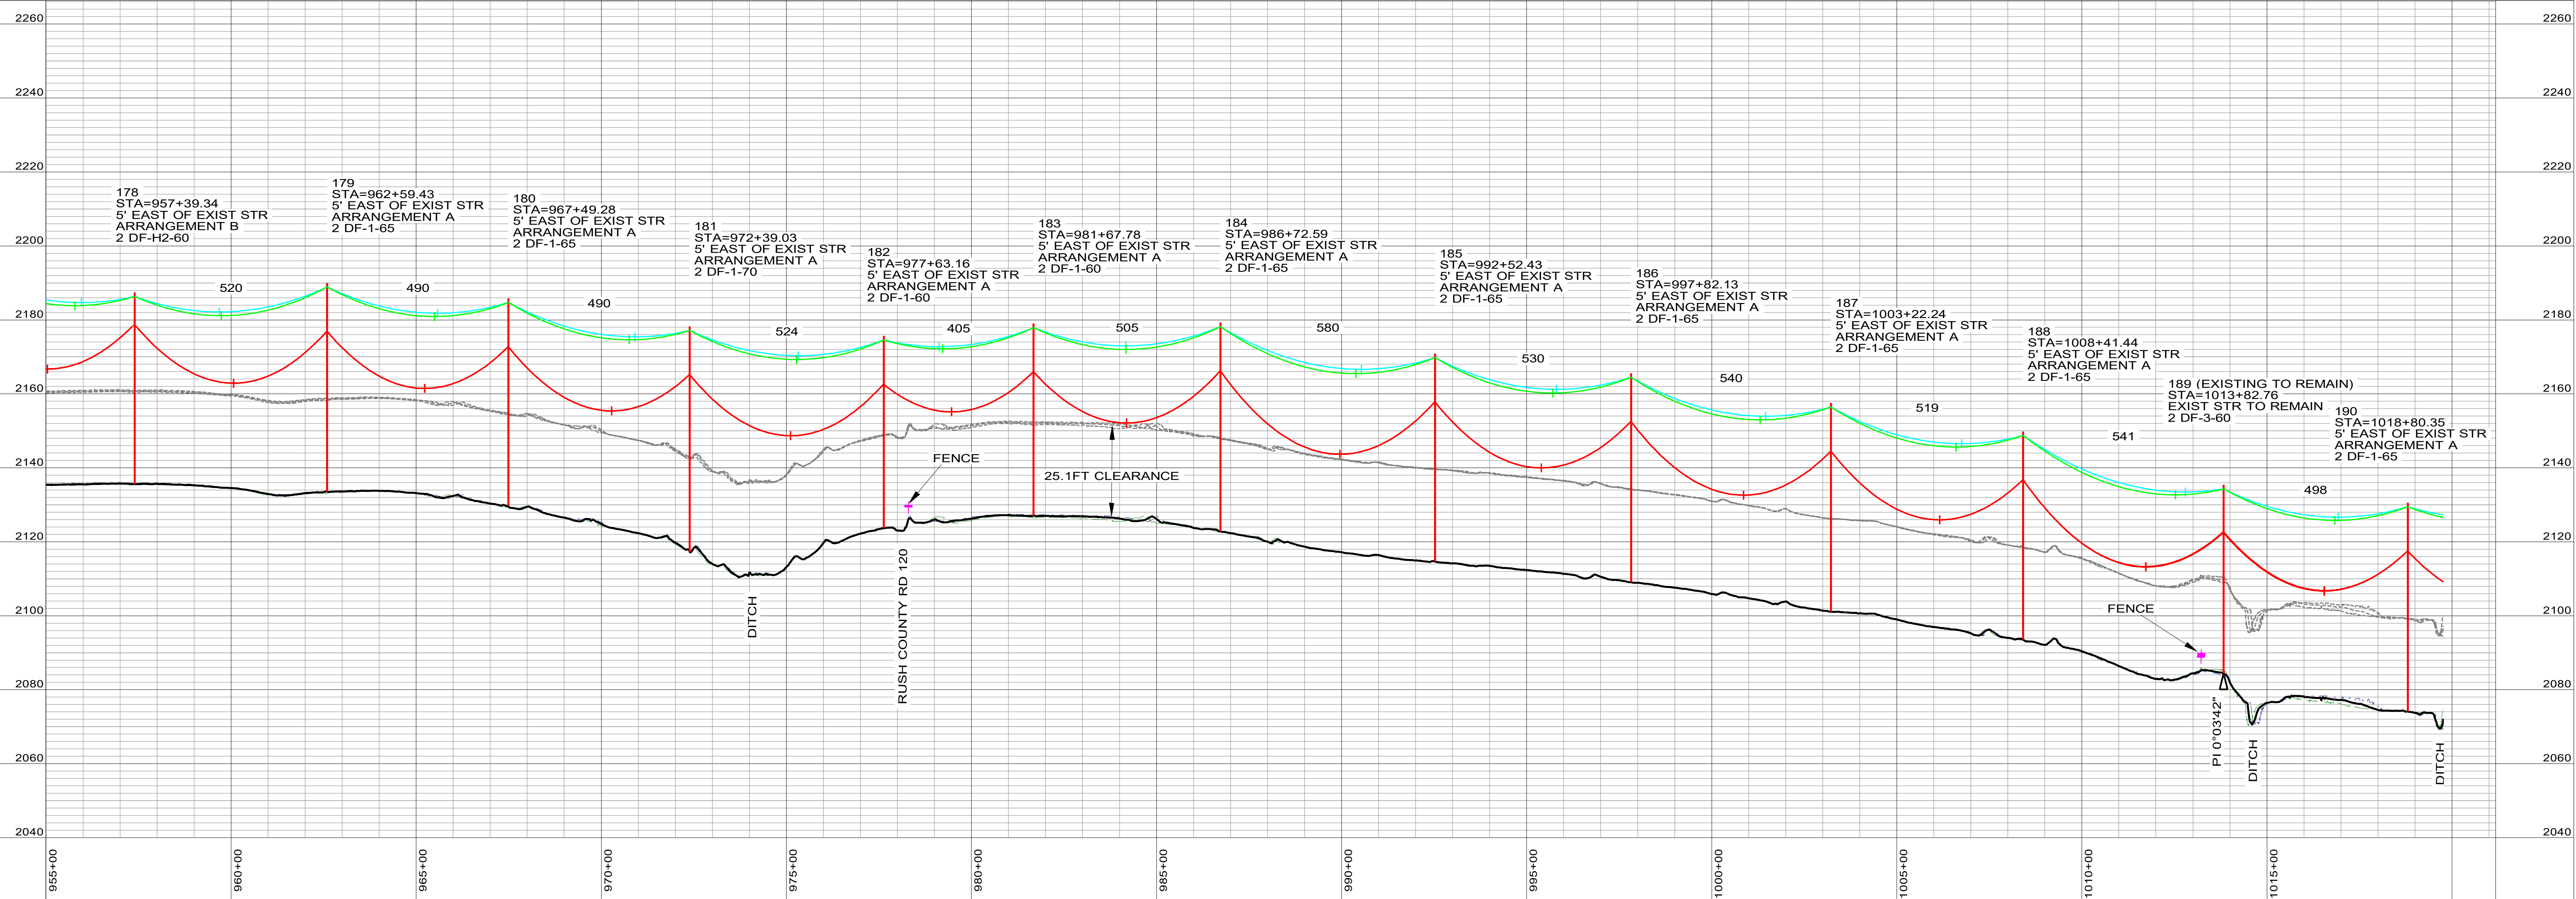

PROPOSED 115-KV
CENTERLINE
DITCH
PROPERTY LINE
WIRE CROSSING
MWE EASEMENT
BOUNDARIES
EXISTING STRUCTURE
LOCATION - TO REMAIN
NEW STRUCTURE LOCATION
TO BE INSTALLED

—————	PI LOCATION
—————	GROUND PROFILE 10' LT
—————	GROUND PROFILE CTR
—————	GROUND PROFILE 10' RT
—————	SHIELDWIRE @ 60° F
—————	OPGW / OHGW @ 60° F
—————	CONDUCTOR @ MAX OP. FENCE

PI LOCATION
GROUND PROFILE 10' LT
GROUND PROFILE CTR
GROUND PROFILE 10' RT
SHIELDWIRE @ 60° F
OPGW / OHGW @ 60° F
CONDUCTOR @ MAX OP.
FENCE




**BURNS
MCDONNELL**

BURNS & MCDONNELL
ENGINEERING CO. INC.
KANSAS REGISTRATION E-65

1	9/25/25	ISSUED FOR CONSTRUCTION - MATERIAL CHANGES		RMV	TJ
0	3/28/25	ISSUED FOR CONSTRUCTION		JRO	TJ
REV.	DATE	DESCRIPTION		BY	APPROVED

DRAWN BY:	J. OLIVAREZ
APPD.:	T. LEWIN
DATE:	7/3/25
CAD NAME:	
SCALE:	VERT 1:20 HOR 1:200



MIDWEST ENERGY, INC.
1330 CANTERBURY RD.
HAYS, KANSAS 67601
(785) 625-3437

LINE 115.02 - NESS CITY-NEKOMA

DRAWING NO. T-PNP-01

SHEET NO. PAGE 17/23

REV.
1